


# REMOTE CONTROL RELAY FOR ELECTRIC CAR LOADS OVER 25 AMPS

CONTACTORS/RELAYS MUST BE SIZED TO SUPPORT LOAD BEING CONTROLLED

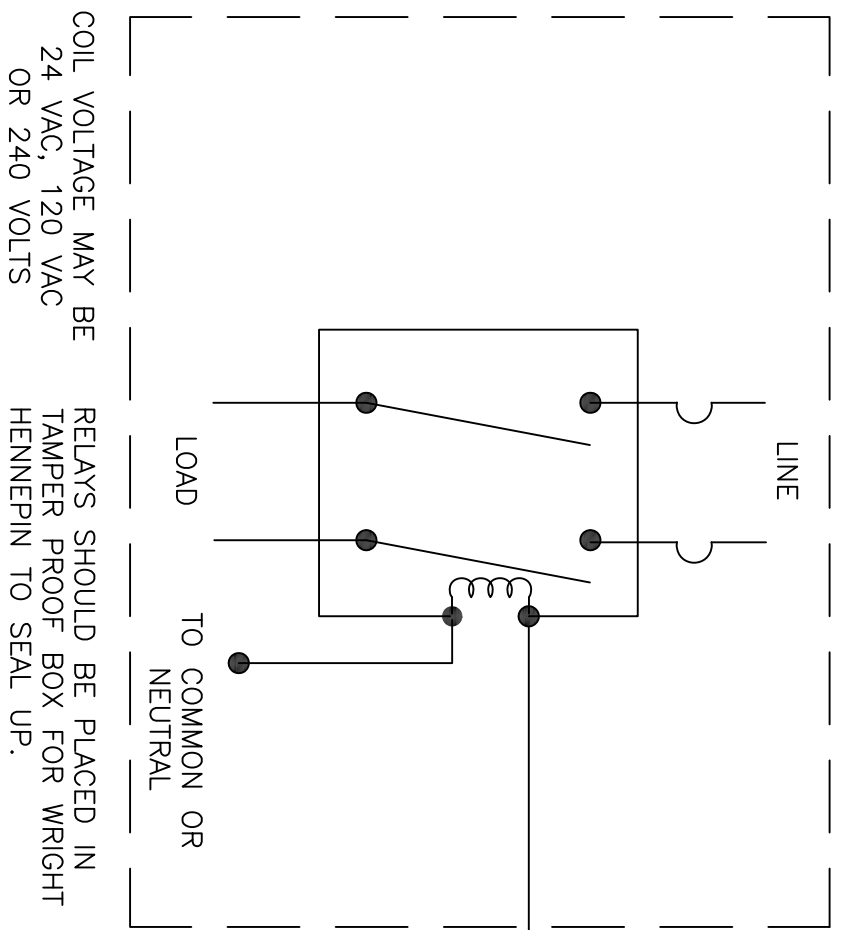


COIL VOLTAGE MAY BE 24 VAC, 120 VAC OR 240 VOLTS  
 RELAYS SHOULD BE PLACED IN TAMPER PROOF BOX FOR WRIGHT HENNEPIN TO SEAL UP.

LOAD MANAGEMENT SWITCH NORMALLY CLOSED DRY CONTACT

SEE NOTES 3 AND 4

**NOTES:**

1. WRIGHT HENNEPIN COOPERATIVE ELECTRIC ASSOCIATION IS NOT RESPONSIBLE OR LIABLE FOR ANY PERSONAL INJURY OR PROPERTY DAMAGE IN THE WIRING OF OR THE OPERATION OF THE ENERGY SAVINGS PROGRAM.
2. LOAD CONTROL SWITCH AND METER SOCKET MUST BE MOUNTED OUTSIDE 4' TO 5' OFF THE GROUND.
3. FOR LANDIS AND GYR SWITCH USE #10 GAUGE ORANGE RELAY WIRE.
4. FOR EATON SWITCH USE #18 GAUGE YELLOW RELAY WIRES.

 <p><b>Wright-Hennepin</b> Cooperative Electric Association A Touchstone Energy Cooperative</p>		<p><b>WRIGHT-HENNEPIN COOPERATIVE ELECTRIC ASSOCIATION</b></p>	
DATE	5/6/2024	DWG BY:	TLG
PROJECT NO.		CHGD BY:	
<p><b>ENERGY AND SERVICES DEPARTMENT</b> 1-800-943-2667</p>		DWG NO.	LM16
<p><b>REMOTE CONTROL RELAY FOR EV</b></p>		APPD BY:	
		SHEET	1 OF 1