



METERED WATER STORAGE

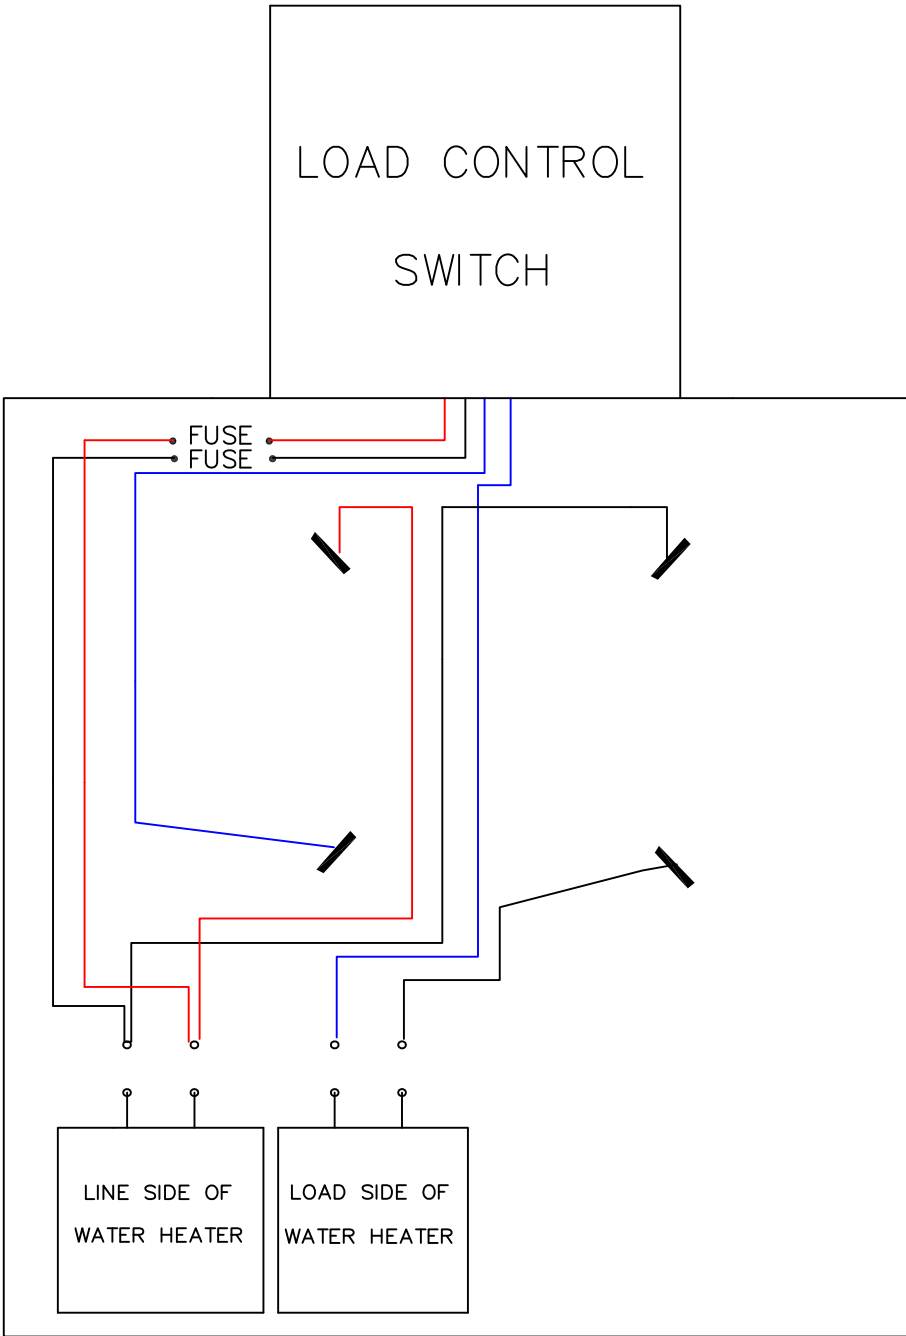

NOTES:

- 1 WRIGHT-HENNEPIN C.E.A. IS NOT RESPONSIBLE OR LIABLE FOR ANY PERSONAL INJURY OR PROPERTY DAMAGE IN THE WIRING OF OR THE OPERATION OF THIS ENERGY SAVINGS PROGRAM.
- 2 ALL WIRING MUST MEET N.E.C. (NATIONAL ELECTRIC CODE) AND BE INSPECTED BY A STATE ELECTRICAL INSPECTOR BEFORE WRIGHT-HENNEPIN WILL INSTALL METER.
- 3 LOAD CONTROL SWITCH AND METER SOCKET MUST BE MOUNTED OUTSIDE 4' TO 5' OFF THE GROUND.
- 4 ANY TIME POWER IS OFF AND RESTORED TO THE LOAD CONTROL SWITCH THERE WILL BE A 15 MINUTE DELAY BEFORE UNIT WILL BE ALLOWED TO OPERATE.

	WRIGHT-HENNEPIN COOPERATIVE ELECTRIC ASSOCIATION		
	ENERGY AND SERVICES DEPARTMENT 1-800-943-2667 METERED WATER STORAGE		
DATE	DWG BY:	DWG NO.	
4/19/2024	TLG	LM18	
PROJECT NO.	SCALE	CHKD BY:	APPD BY:
	N/A		SHEET 1 OF 1