



SINGLE UNIT UNCONTROLLED
GROUND SOURCE HEAT PUMP

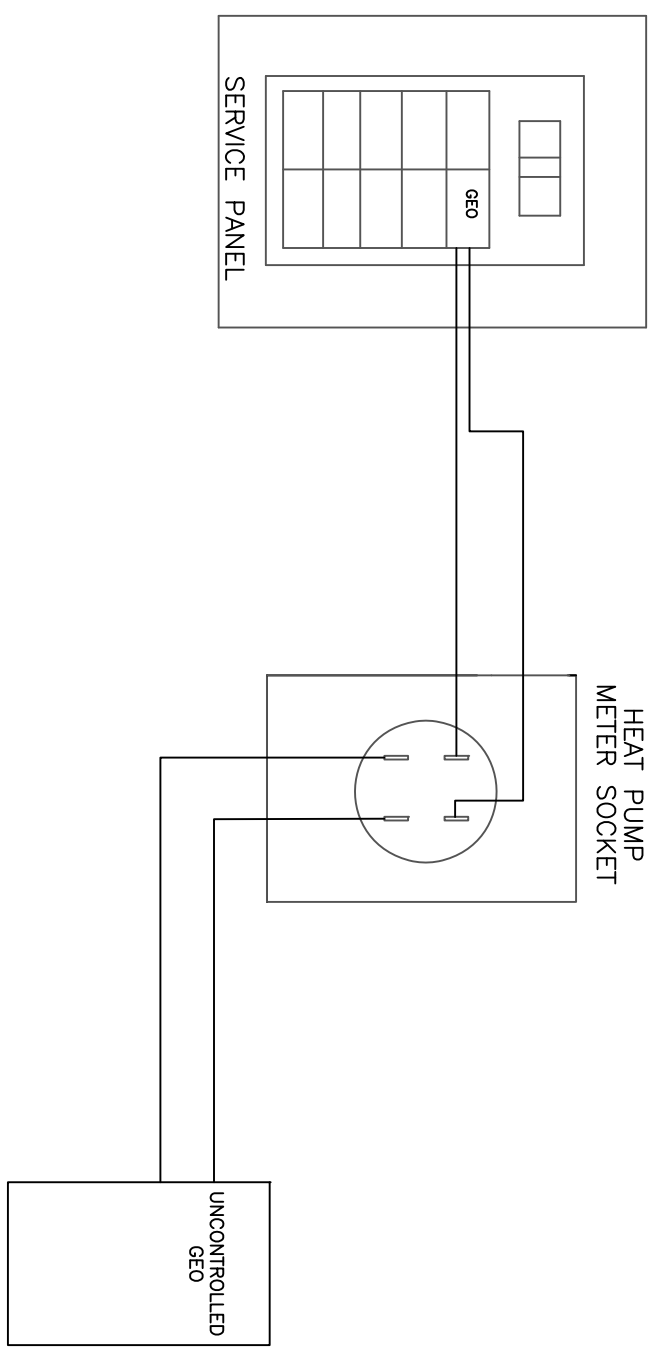

1. Wright Hennepin Cooperative Electric Association will not be responsible or liable for any personal injury or property damage in the wiring of or the operation of this or any Energy Savings Program. Wright Hennepin recommends the use of a licensed electrical contractor.
2. All wiring must meet N.E.C. (National Electrical Code) and be inspected by a state electrical inspector before Wright Hennepin will check out installation, credit KWH usage or issue any applicable rebates.
3. meter socket must be mounted 4' to 6' above the ground outside of all structures with ample access around unit.

 <p>Wright-Hennepin Cooperative Electric Association A Touchstone Energy® Cooperative</p>		<p>WRIGHT-HENNEPIN COOPERATIVE ELECTRIC ASSOCIATION</p> <p>ENERGY AND SERVICES DEPARTMENT 1-800-943-2667</p> <p>DIRECT SOCKET UNCONTROLLED GEO</p>	
DATE 4/19/2024		DWG NO. LM25	
PROJECT NO. --	SCALE N/A	CHGD BY:	APPR BY:
		SHEET 1 OF 1	